


## METER VAULT FOR 2" DOMESTIC W/OMNI METER & 4" TO 8" FIRE LINES

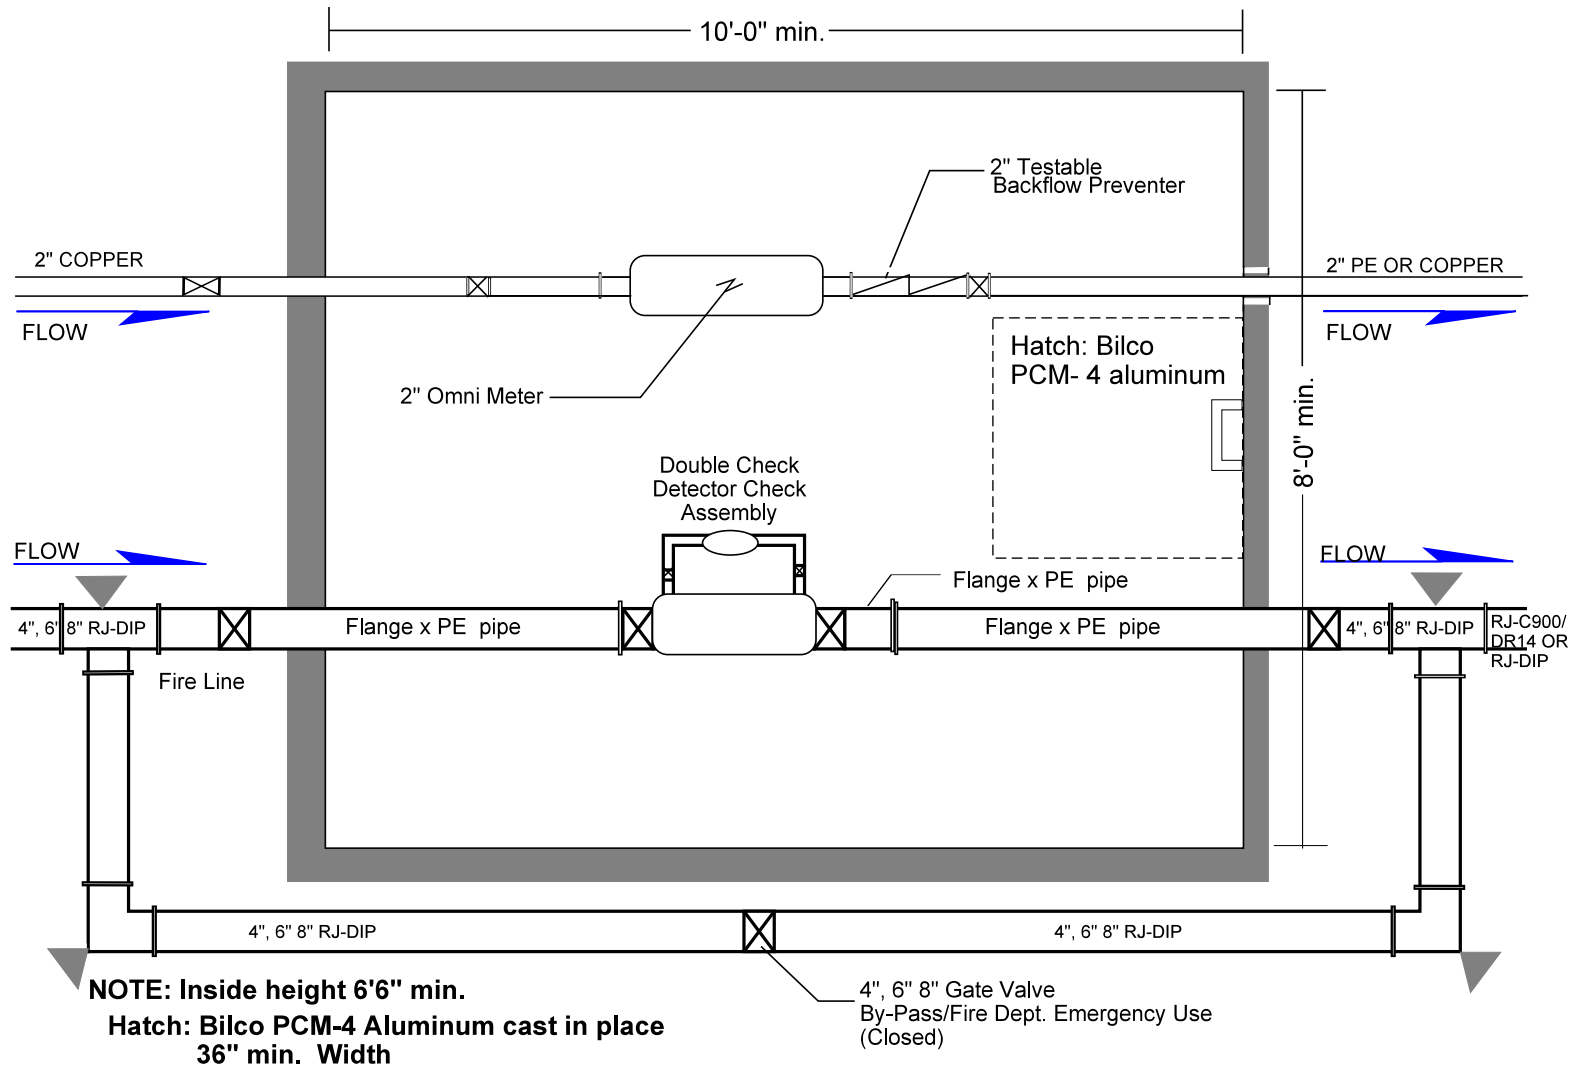

### NOTES:

1. Hatch location may be moved with Authority approval.
2. Mega-lugs must be used on all fittings and valves or the fittings must be rodded (4 min.) and anchored in concrete.
3. Concrete Thrust Blocks must be used on all underground bends & tee's.
4. Vault size may need adjusted to accommodate the different sizes of fire lines.

**Number 1**