


METER PIT FOR 4" DOMESTIC W/3" or 4" METER & 4" to 8" FIRE LINES

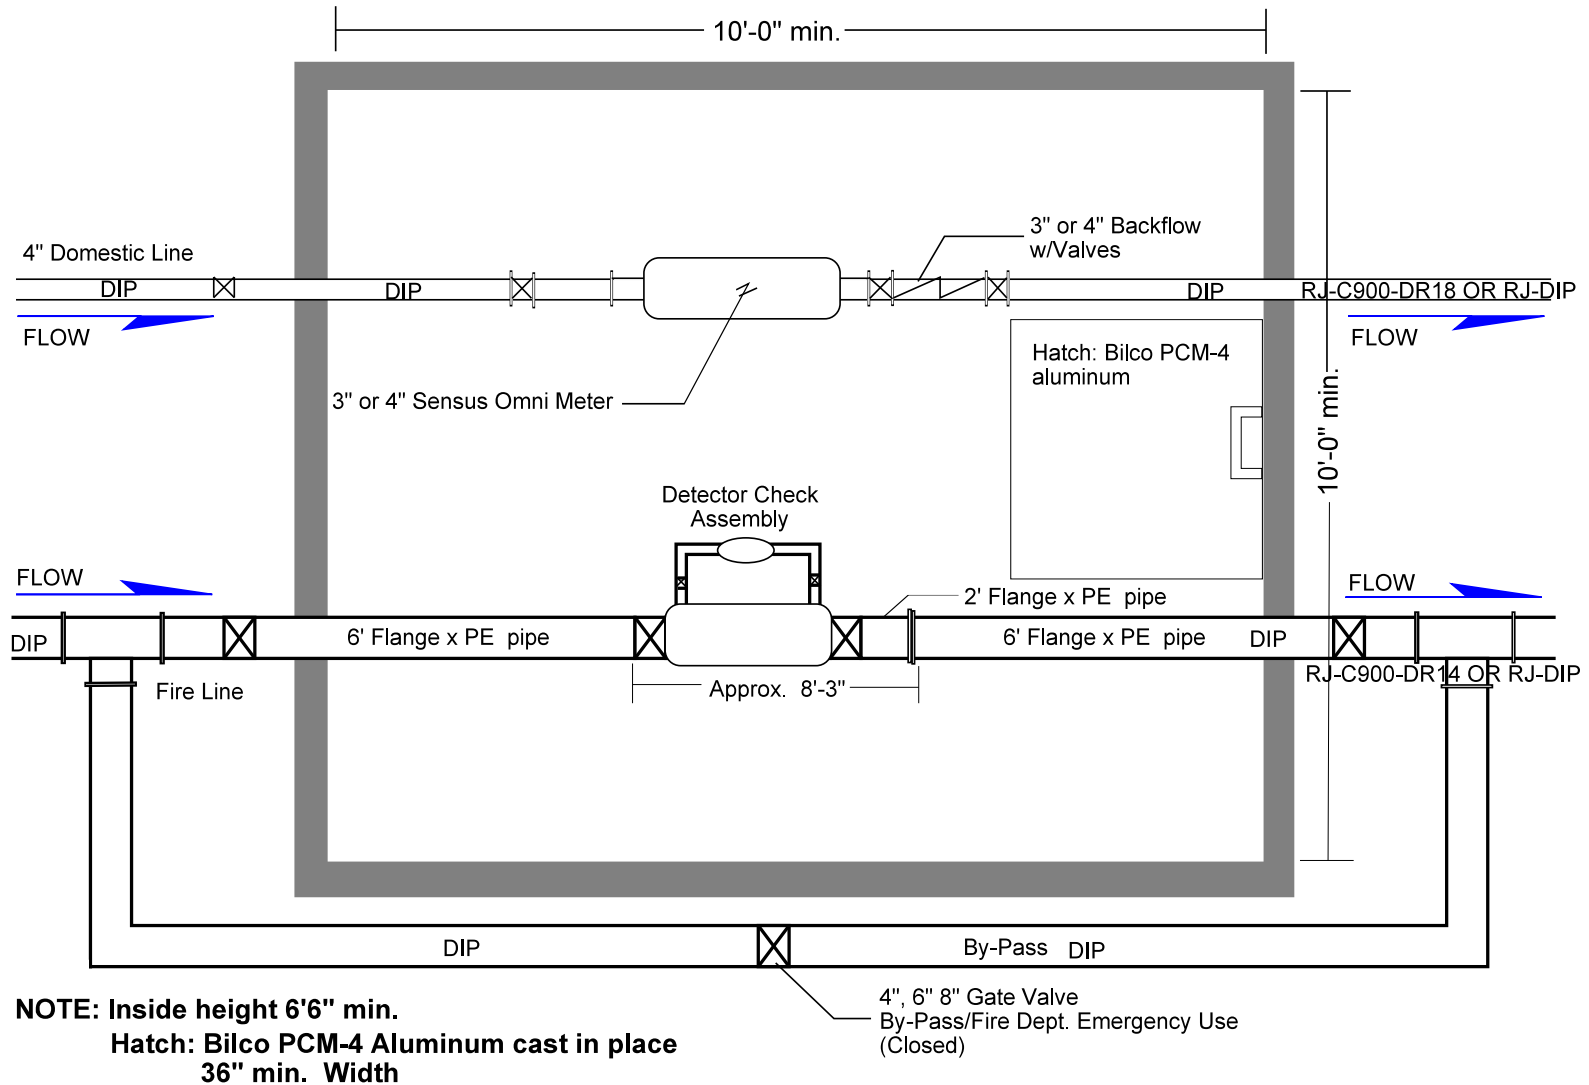

NOTES:

1. Hatch location may be moved with Authority approval.
2. Mega-lugs must be used on all fittings and valves
3. Concrete Thrust Blocks must be used on all underground bends & tee's.
4. Owner to purchase, take delivery and install the 3" or 4" meter. Authority personnel will inspect installation.